


H:\Dalton Utilities\Sewer\Details\S1A - Bedding for HDPE Pipe for LPSS Application.dwg, A SIZE, 1/24/2006 11:13:52 AM

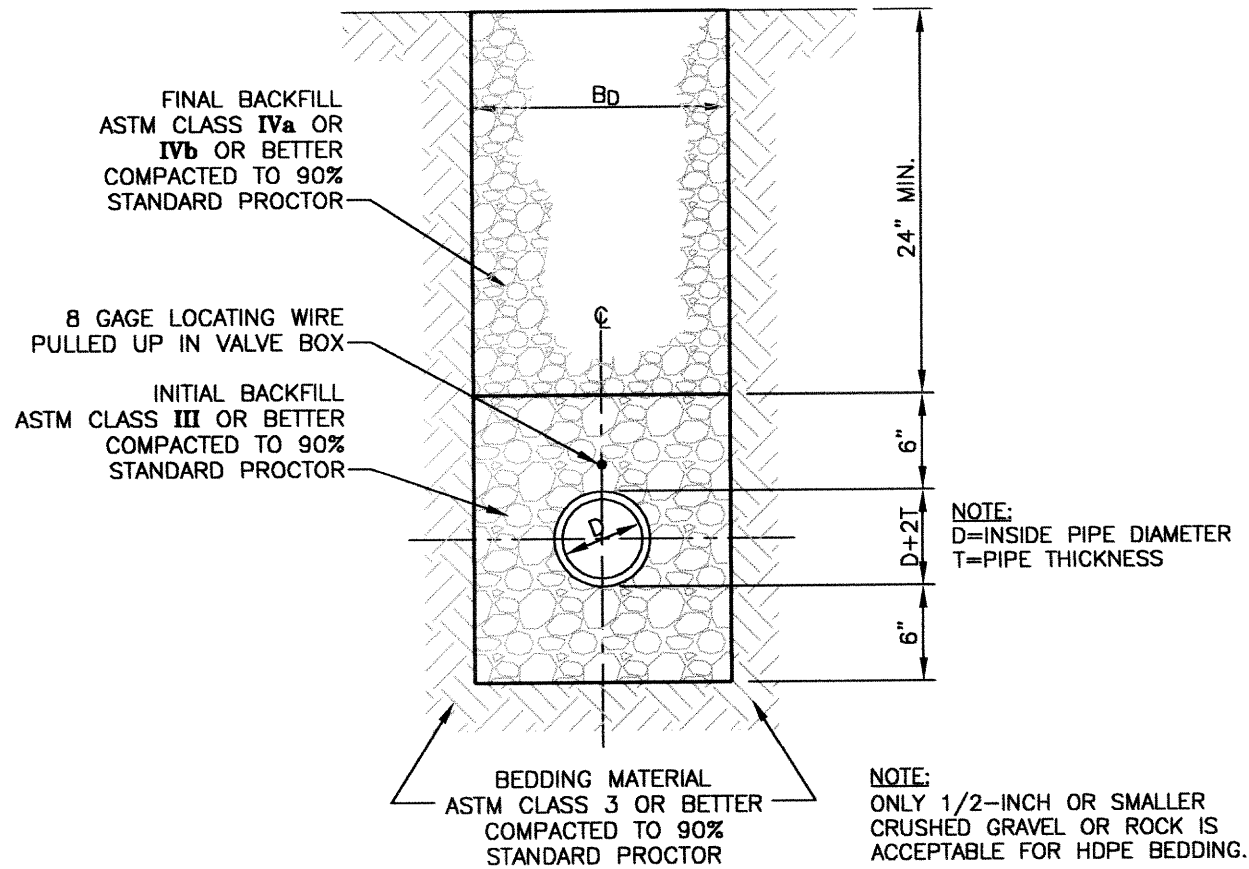

| TRENCH WIDTH | |
|---|------------------------------|
| MINIMUM TRENCH WIDTH B_D (INCHES) | PIPE DIA. D (INCHES) |
| 13.25 | 1.25 |
| 14 | 2 |
| 14.5 | 2.5 |
| 15 | 3 |

| MINIMUM OPEN TRENCH LENGTH (FEET) | | | |
|--------------------------------------|--------|------------------------|----|
| | | DEPTH OF TRENCH (FEET) | |
| | | 3 | 5 |
| PIPE SIZE (INCHES) | 1.25-3 | 15 | 20 |
| | 4 | 25 | 30 |

BEDDING FOR HDPE PIPE FOR LPSS APPLICATIONS

N.T.S.



DALTON UTILITIES
E N G I N E E R I N G S E R V I C E S
DALTON, GEORGIA 30721
1200 V D PARROTT JR PKWY (706) 278-1313

REVISED: .
REVISED: .
REVISED: .
REVISED: 01/24/2006

FIGURE NO.:

S1A